

AMBIANE POWER™ RACK


INSTALLATION INSTRUCTIONS




The unit must be installed by a qualified electrician in accordance with all national and local electrical and construction codes and regulations. This device falls under class I and must be grounded!




The Ambiane Power Rack has 8 LED outputs and is desing for mounting into 19-inch equipment rack.

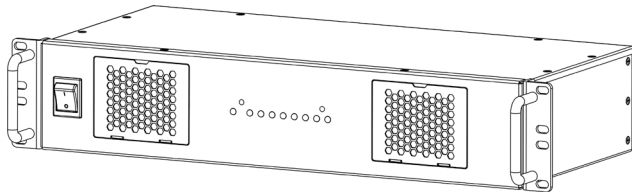

STEP 1 AMBIANE POWER RACK CONNECTION (ONLY POWER)

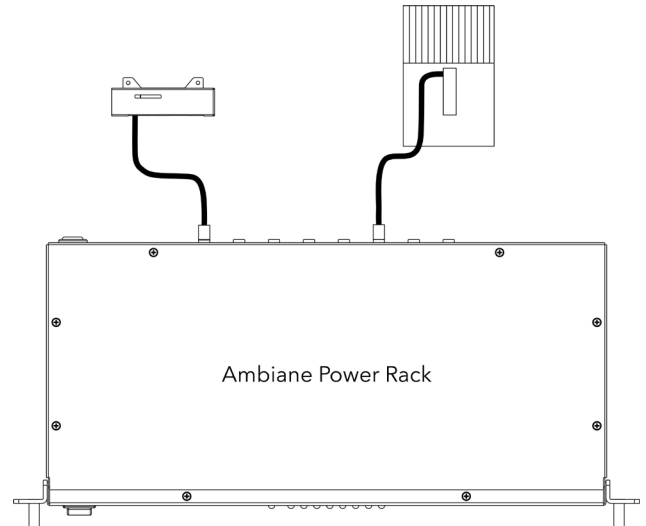

Connection of Ambiane HP and Ambiane XP power cables into the Ambiane Power Rack.


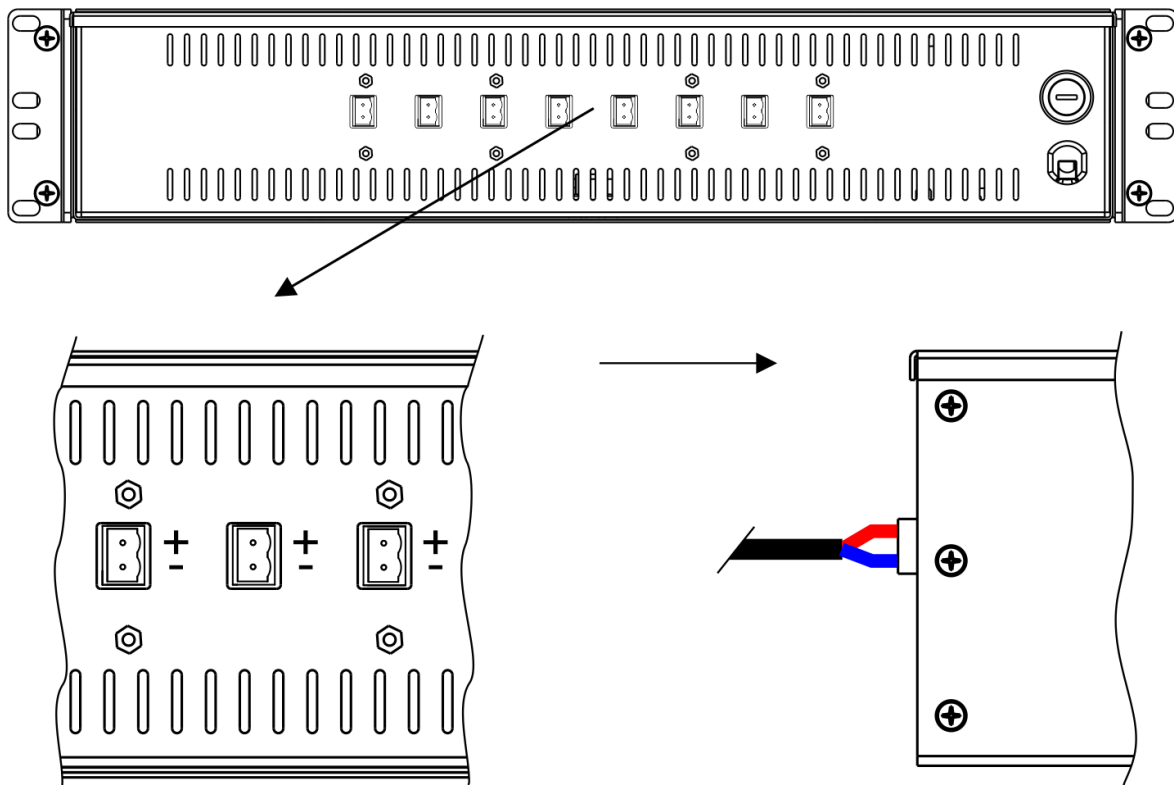


Install a terminal block on power cable and connect it to the Ambiane Power Rack.


AMBIANE POWER™ RACK

INSTALLATION INSTRUCTIONS

STEP 2 AMBIANE POWER RACK INSTALLATION

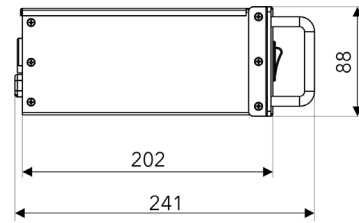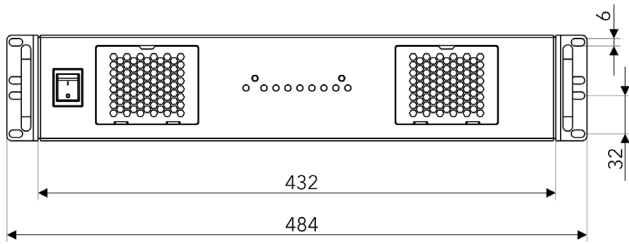


1

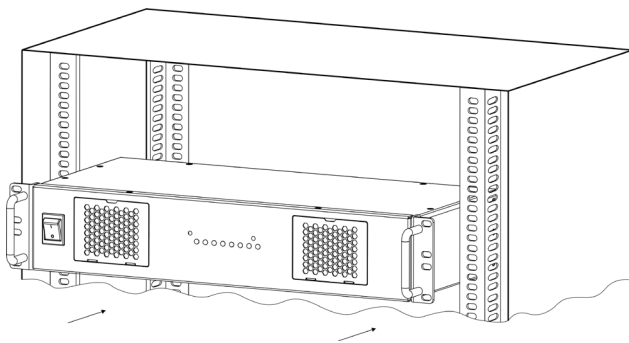

Insert Ambiane Power Rack into the rack case.

2

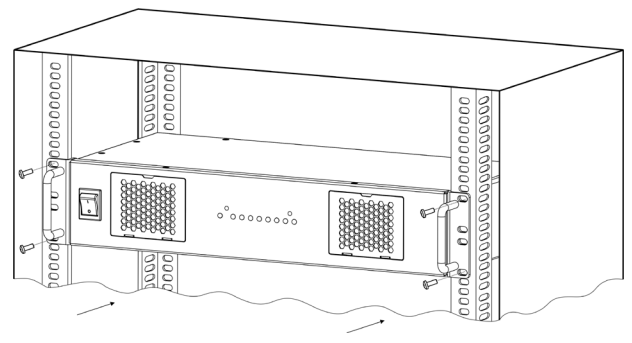

Fasten the Ambiane Power Rack into rack by means of two screws on each side of the Ambiane Power Rack.